
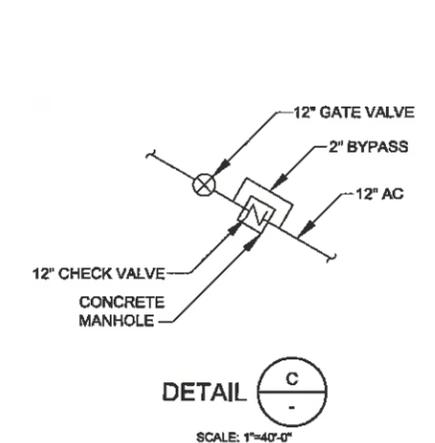
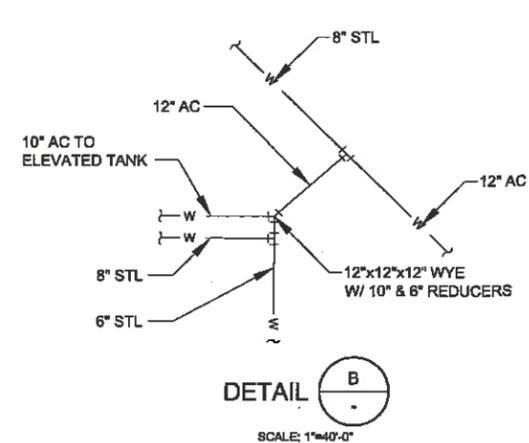
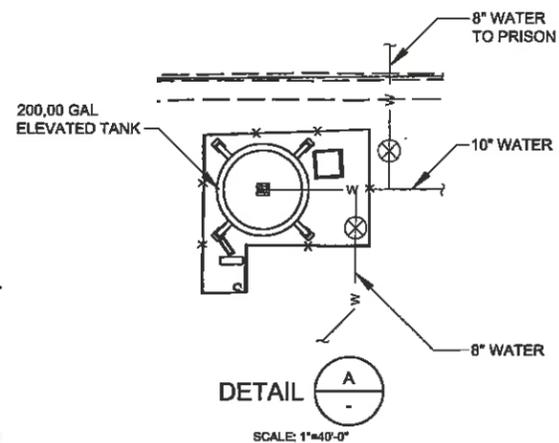


GENERAL NOTES:
 1. ALL WATERLINES ARE 6" UNLESS OTHERWISE NOTED.

ARIZONA
 DEPARTMENT OF
 CORRECTIONS
 FACILITY

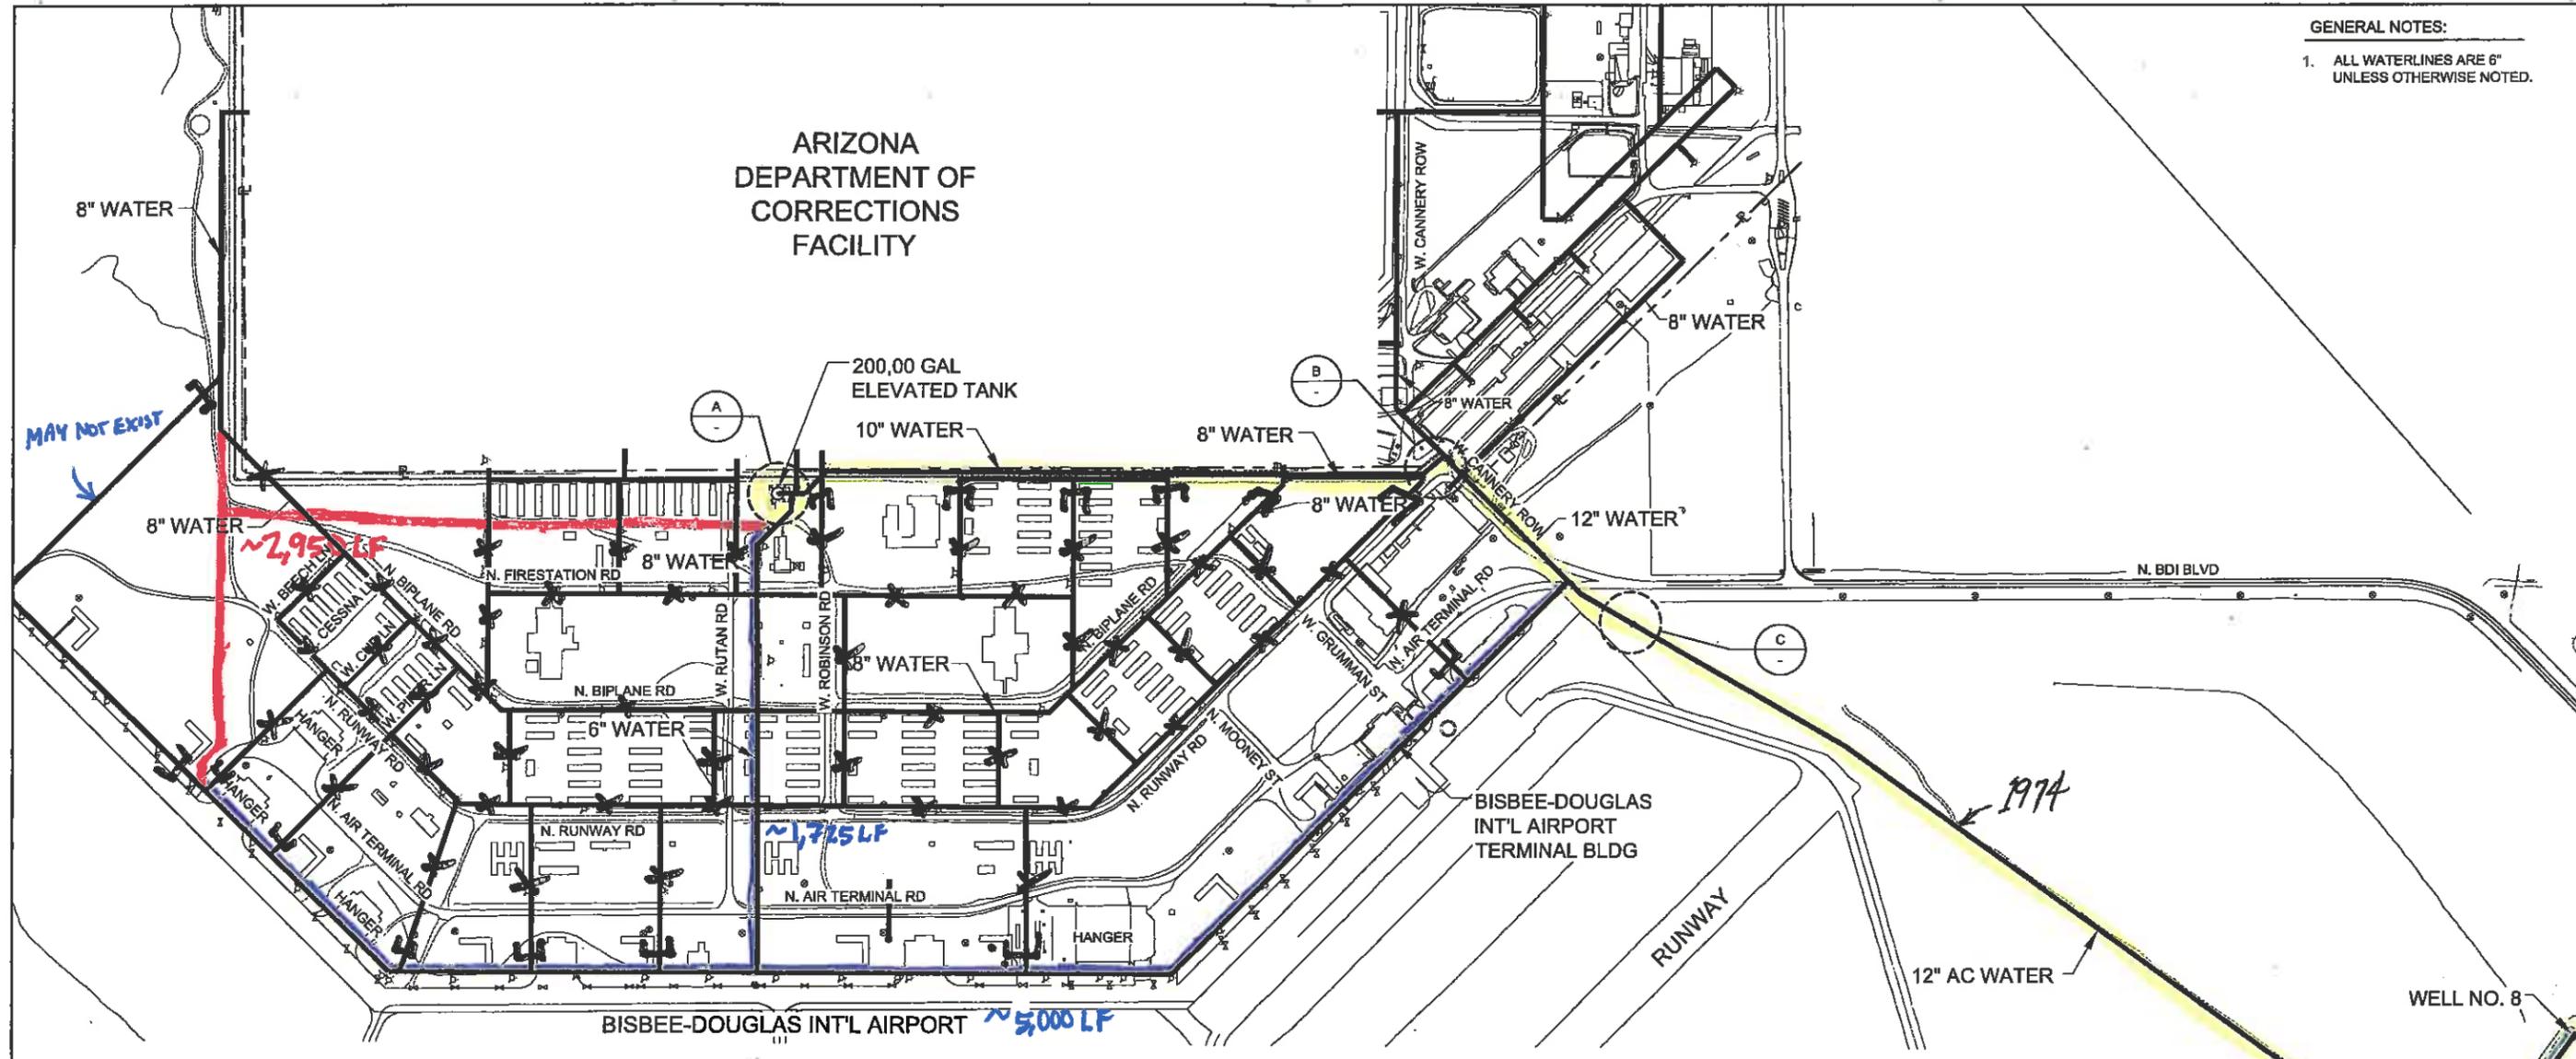

- LEGEND
- ⊙ WATER MANHOLE
 - ⊕ WATER VALVE
 - ⊗ FIRE HYDRANT

~6,650 LF
 ~2,950 LF
 ~6,725 LF
 Figure 3-2

EXISTING WATER SYSTEM

BISBEE-DOUGLAS
 INTERNATIONAL AIRPORT
 DOUGLAS, ARIZONA

